


Anschluß für FS-Berät.  
Differenzträger - Ton.

Netz 220 V ~  
Instr. 333 Ω/V  
R0 1 u 2 UKW  
R0 3 7 MW 1MHz


Kreftt Weltfunk W 539

TA (H)	LW (G)	MW (F)	MW-RA (E)	KW (D)	FD (C)	UKW (BA)
0	0	0	0	0	0	0
0	0	0	0	0	0	0
0	0	0	0	0	0	0
0	0	0	0	0	0	0
0	0	0	0	0	0	0
0	0	0	0	0	0	0
0	0	0	0	0	0	0
0	0	0	0	0	0	0

Grucktasensatz Mayr T 400/7 von unten gesehen, auf UKW geschaltet

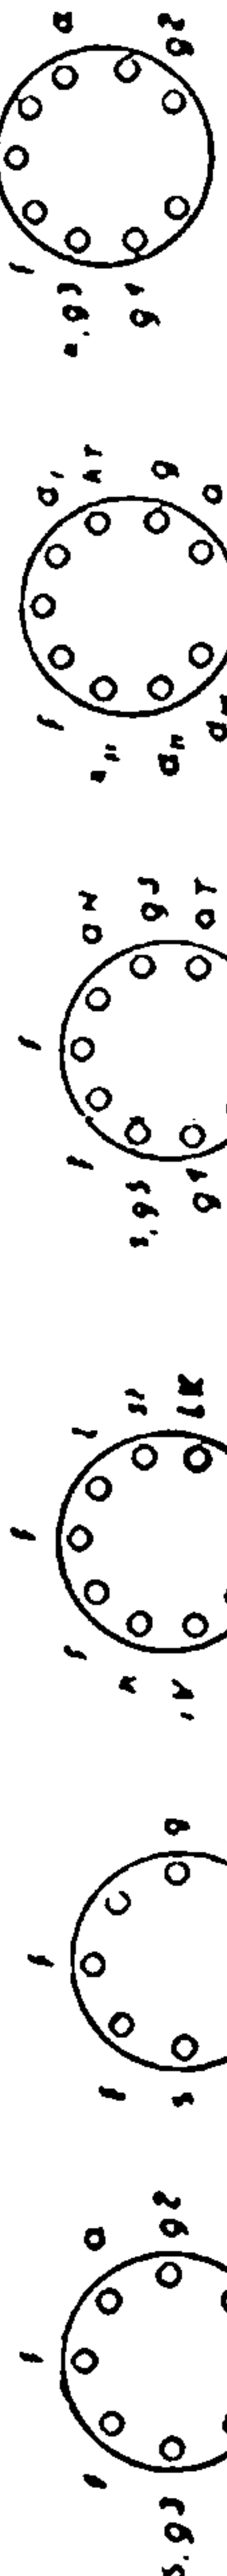


EF 93  
EC 92  
EM 85  
ECH 81  
EABC 80  
EL 84

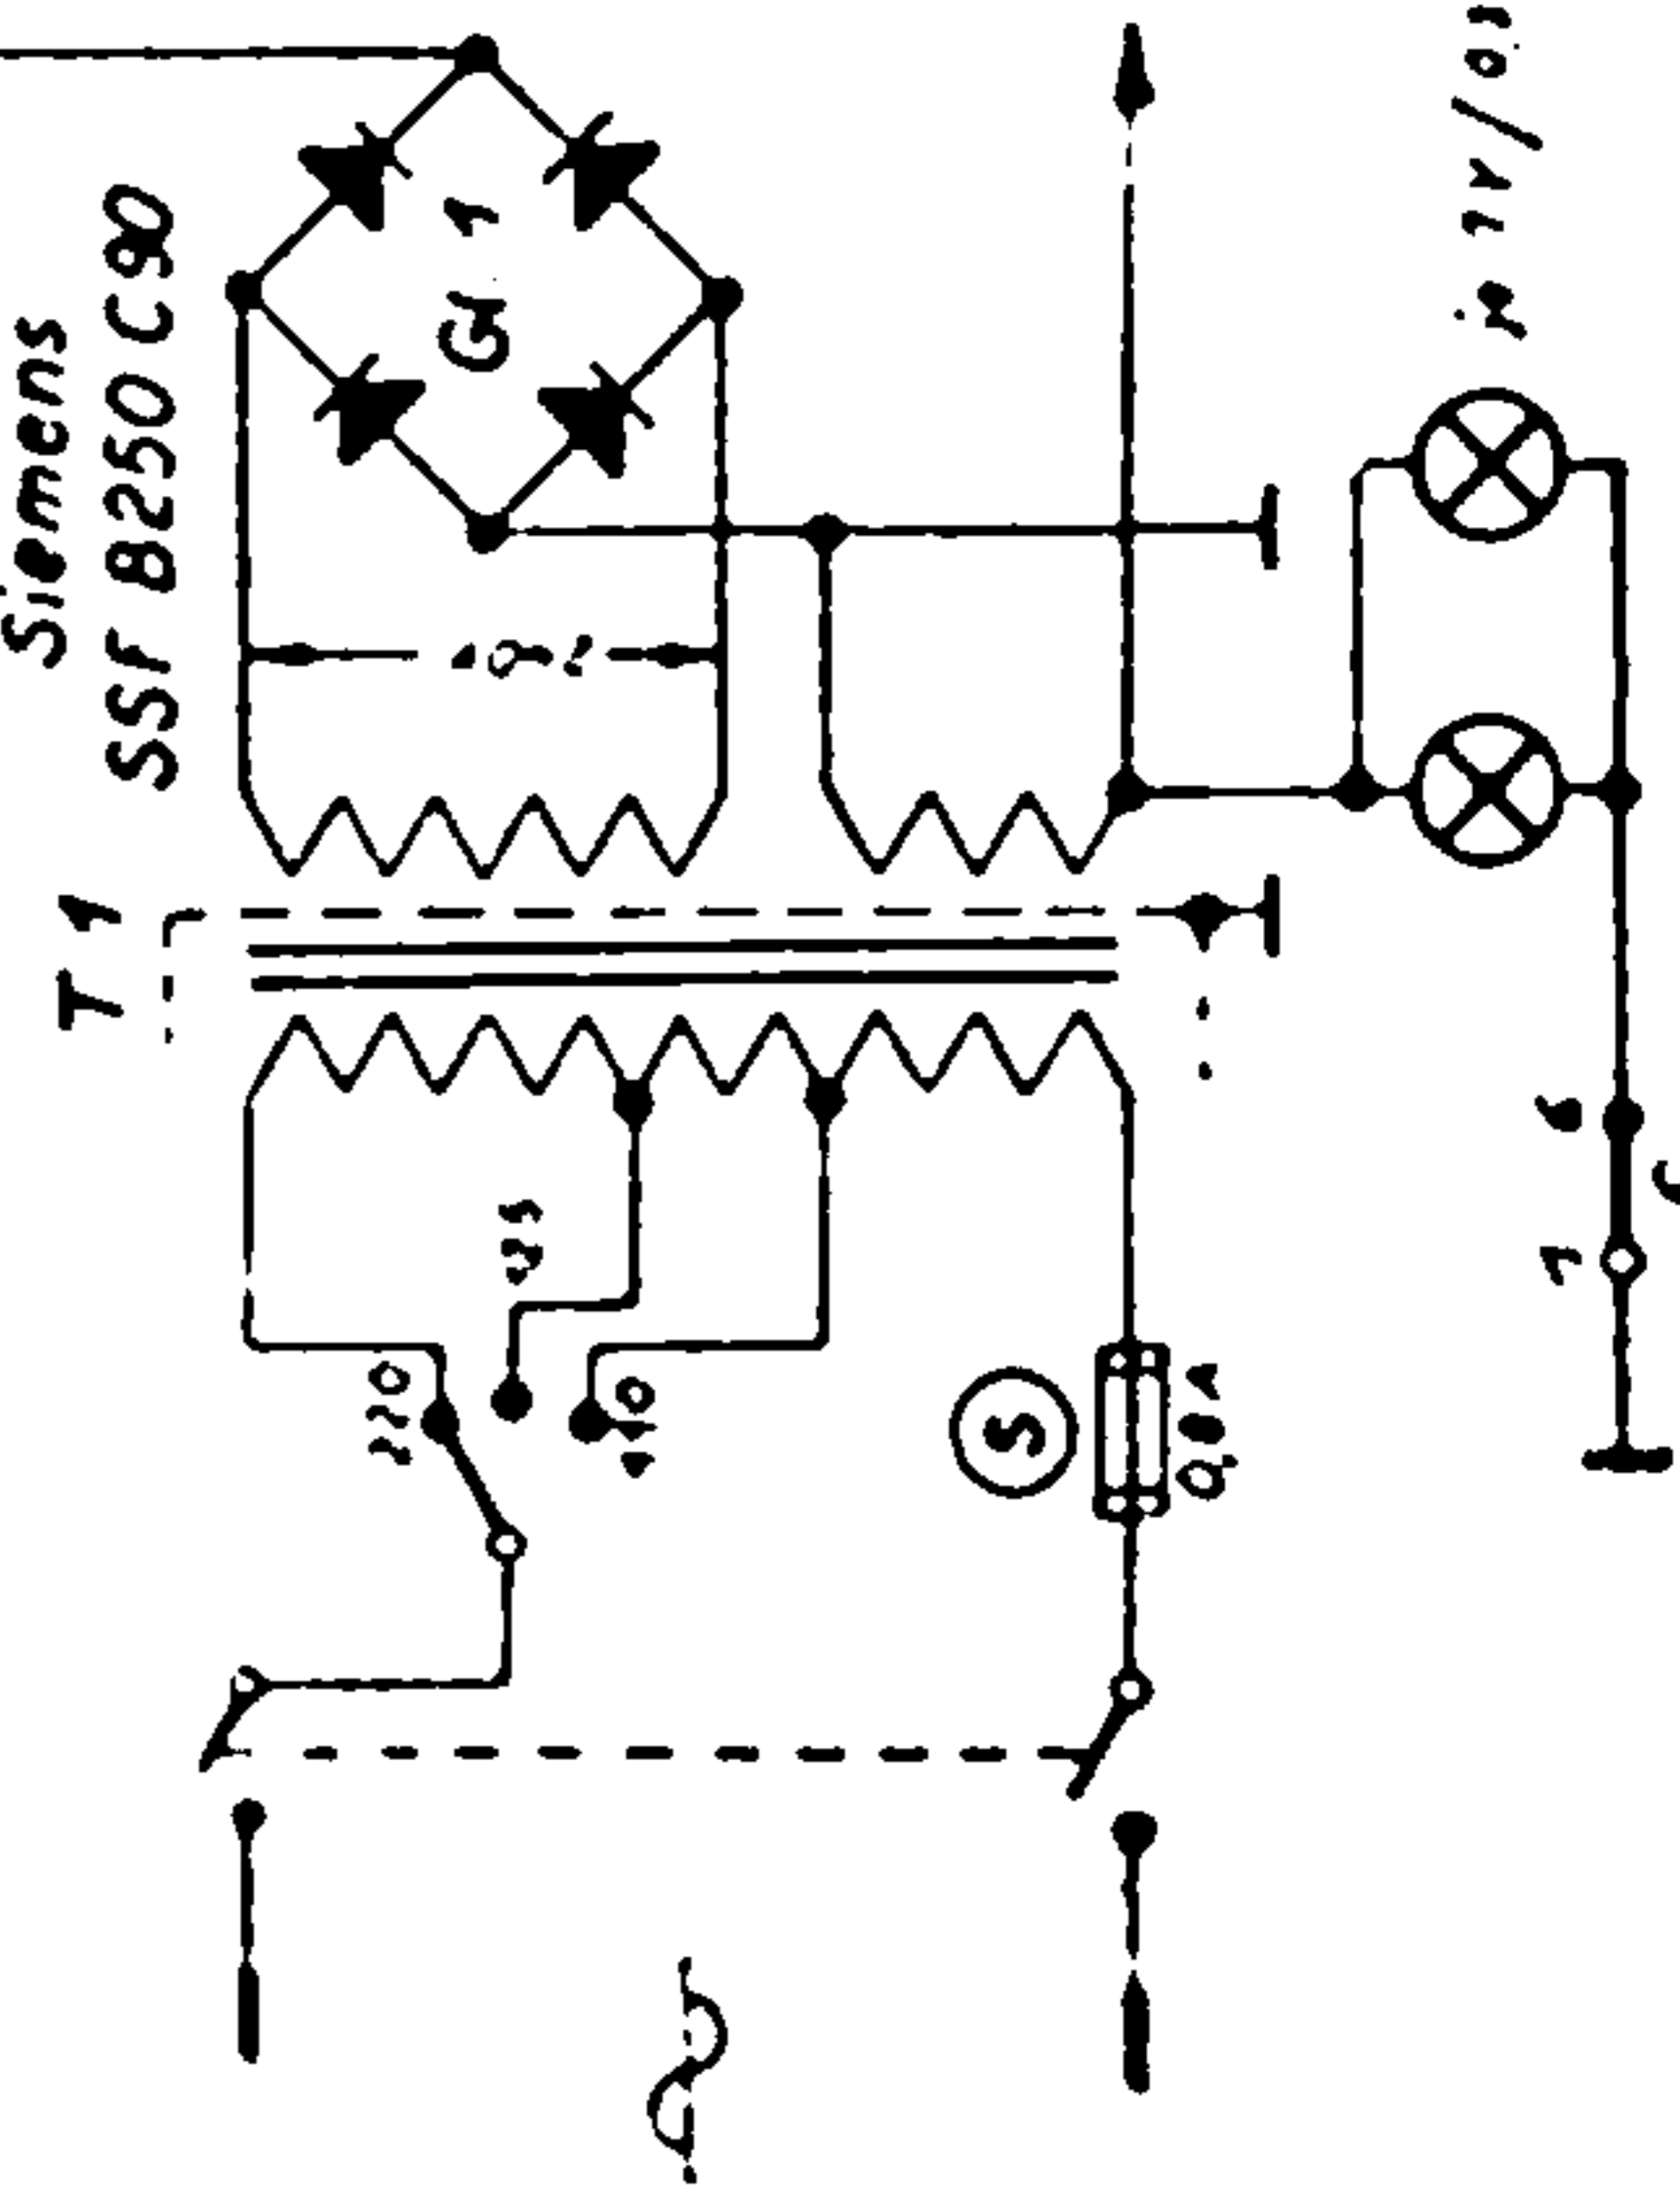

Siemens

T1 SSF B250 C90

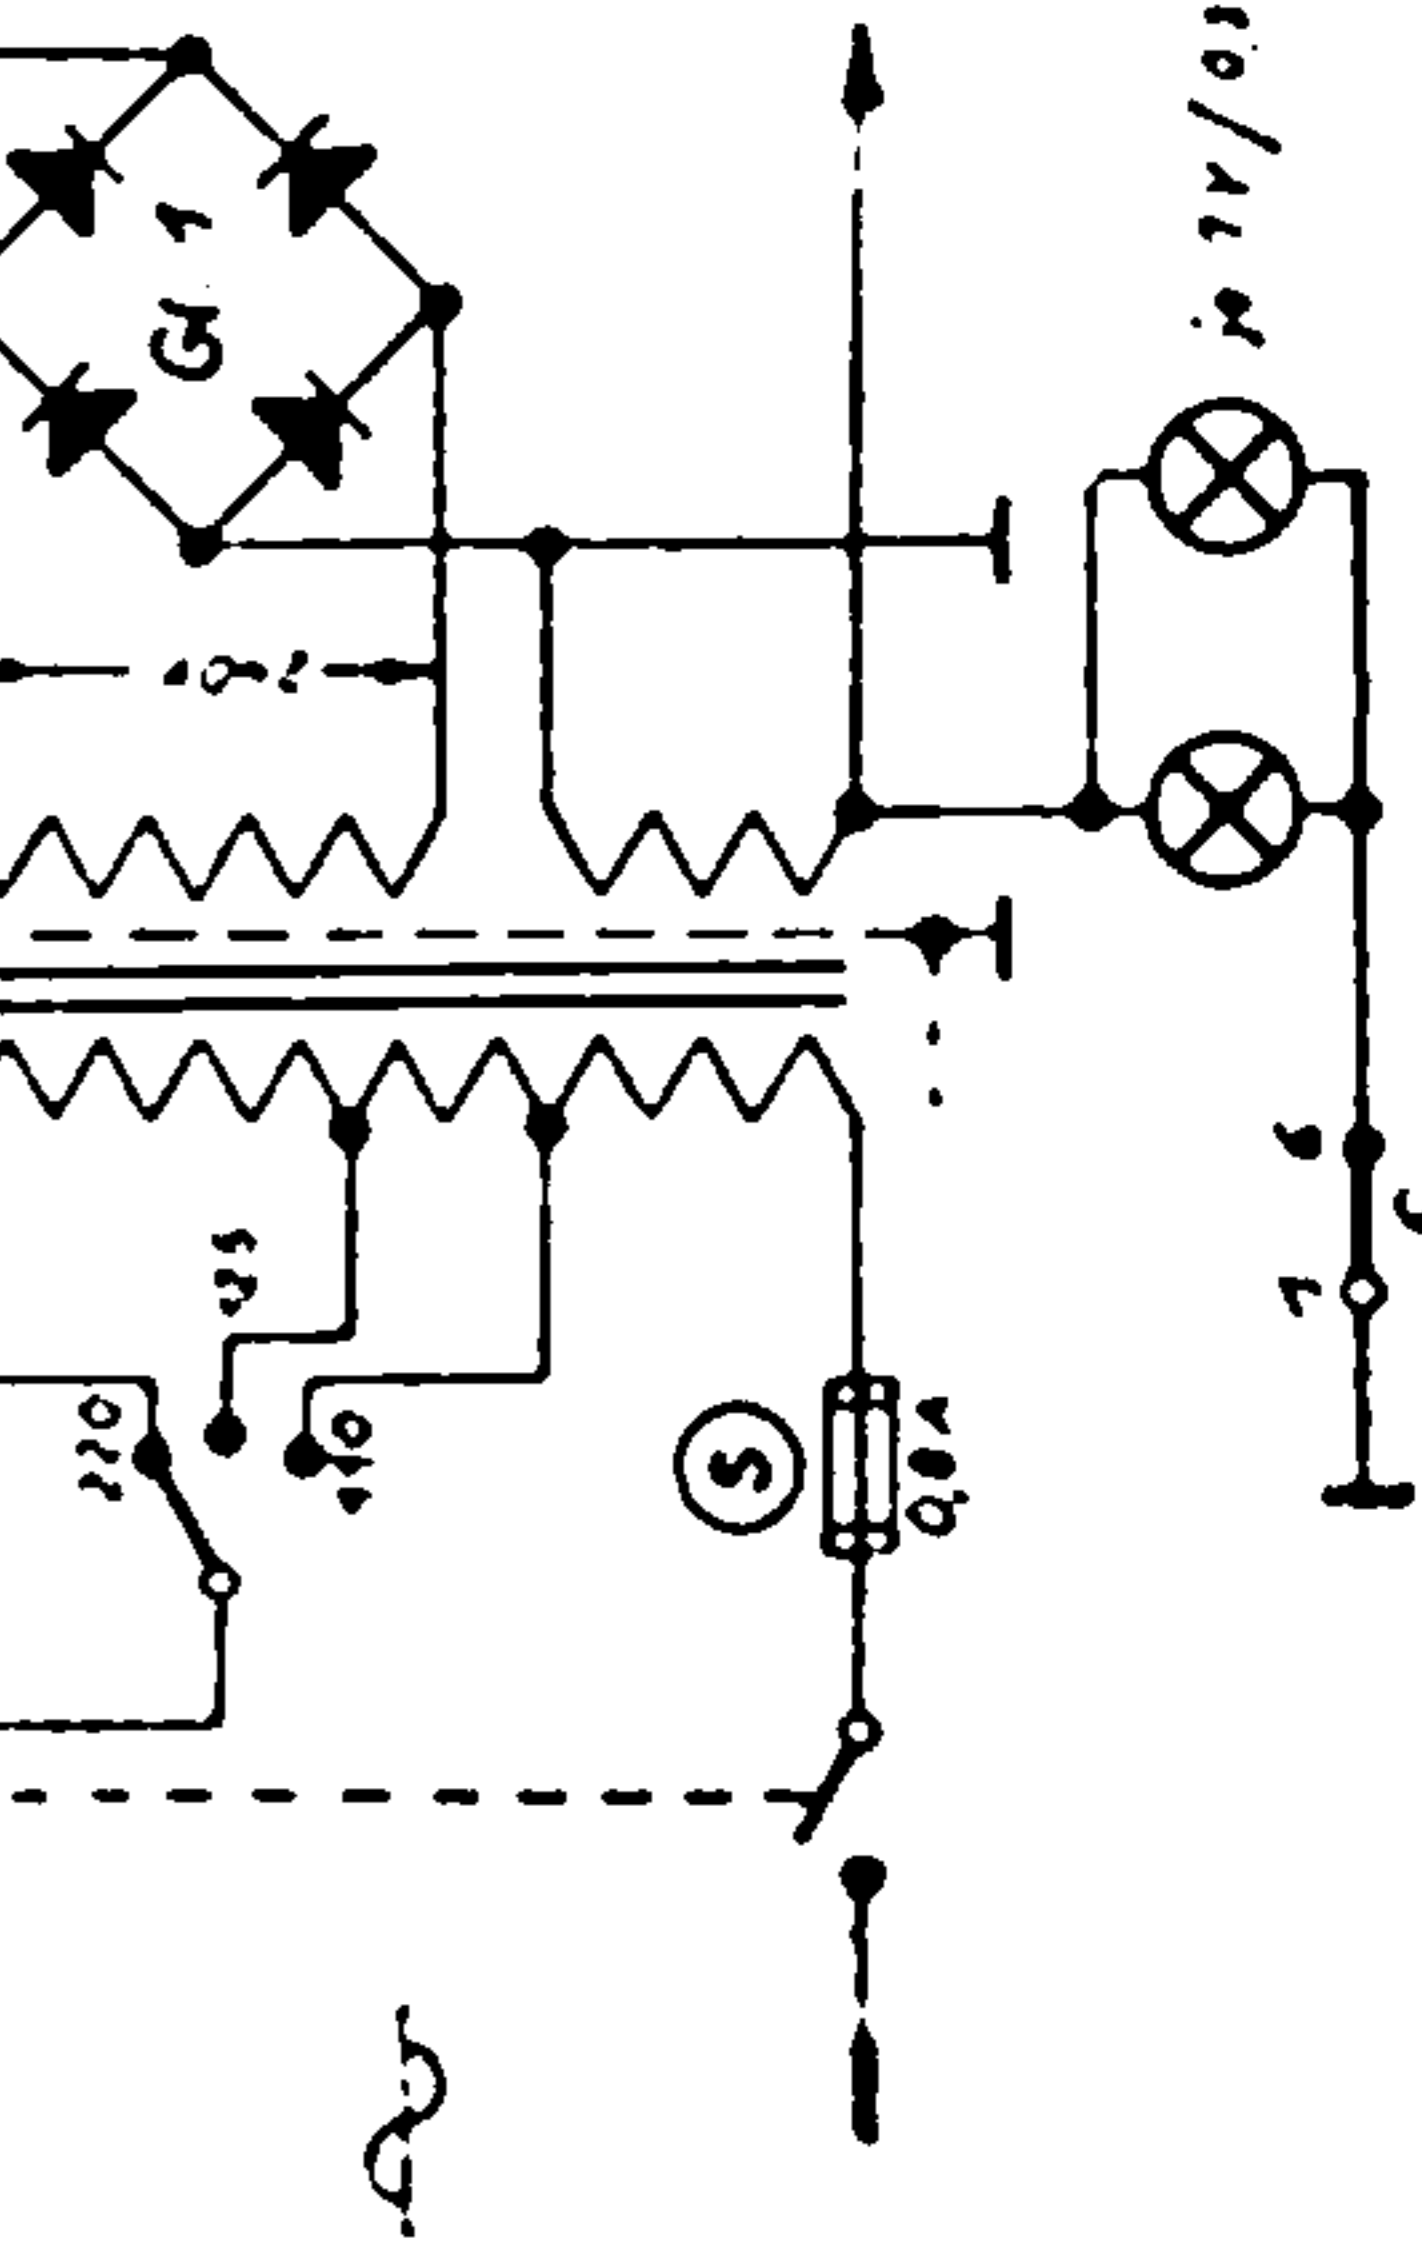

in 110/014